

Model IGP25 I/A Series[®] Multirange Gauge Pressure Transmitter with HART[®] or FOUNDATION[™] Fieldbus Communication Protocol



TRANSMITTER
STRUCTURE CODES
52, 53, D5, D6,
S5, S6, SH, AND SJ



TRANSMITTER
STRUCTURE CODES
22, 23, D1, D2,
S3, S4, SC, AND SD

The Foxboro[®] brand I/A Series Model IGP25 Transmitter is an intelligent multirange two-wire transmitter that provides precise, reliable measurement of gauge pressure, providing the measurement range and performance of “two transmitters in one.” It transmits a 4 to 20 mA or digital output signal, as applicable, using HART[®] or FOUNDATION[™] Fieldbus communication protocol for remote configuration, calibration, and monitoring.

FEATURES

- ▶ Silicon strain gauge sensors successfully field-proven in many thousands of installations.
- ▶ Wide measurement spans from 3.5 to 14 000 kPa (0.5 to 2000 psi) using only two sensors, each having 400:1 turndown capability.
- ▶ Multirange transmitters simplify planning, ordering, and spares procurement and stocking
- ▶ Digital precision, stability, and resolution ensure top measurement performance.
- ▶ Local configuration available with the optional LCD Indicator with on-board pushbuttons.
- ▶ Simple, elegant sensor design uses very few parts to achieve exceptionally high reliability. All welded sensor assembly requires no gaskets to contain process pressure.
- ▶ Fieldbus versions FISCO/FNICO compliant.
- ▶ Durable aluminum or 316 ss housing available; both meet NEMA 4X and IP66 ratings.
- ▶ Industry standard 316L ss offered for process connection and sensor wetted parts material.
- ▶ CE marked; complies with applicable EMC, ATEX, and PED European Union Directives. See inside pages.
- ▶ Can be provided as a sealed measurement system comprising the transmitter with direct mount or remote capillary connected seals.
- ▶ Dual Seal Certified by CSA to meet ANSI/ISA 12.27.01-2003 requirements.

- ▶ Multi-marking is available for HART electronic versions for FM, CSA, and ATEX intrinsically safe installations. The user determines and permanently marks on the data plate the certification to be applied.
- ▶ Designed for hazardous area installations. Versions available to meet Agency flameproof and zone requirements.
- ▶ Optional mounting bracket sets allow pipe or surface mounting. Also many other options.
- ▶ Standard 5-year warranty; 17-year optional.

I/A Series PRESSURE TRANSMITTER FAMILY

The I/A Series Electronic Pressure Transmitters are a complete family of d/p Cell[®], gauge, absolute, multirange, multivariable, and premium performance transmitters, as well as transmitters with remote or direct mount seals, all using field-proven silicon strain gauge sensors and common topworks.

MULTIRANGE FUNCTIONALITY

The turndown ratio for span adjustment is 400:1. This means that the IGP25 transmitter with its 1400 kPa (200 psi) URL sensor can be set to provide a 4 to 20 mA output for any range between 0 to 3.5 and 0 to 1400 kPa (0 to 5 and 0 to 200 psi). Similarly, the IGP25 transmitter with its 14 MPa (2000 psi) URL sensor covers any range between 0 to 0.035 and 0 to 14 MPa (0 to 5 and 0 to 2000 psi). This means that each sensor covers the ranges normally requiring two separate transmitters.

TRUE MULTIRANGE CAPABILITY

Excellent performance is maintained over a very wide turndown range. The transmitter provides not only the functionality of two transmitters in one, but also provides performance that could previously be attained only by selecting one of several different sensors.

MULTIRANGE PERFORMANCE

Accuracy of $\pm 0.050\%$ of span is maintained for a span adjustment turndown range of 80:1, and does not exceed $\pm 0.075\%$ of span until a full 120:1 turndown is reached. Most competitive transmitters have an error greater than $\pm 0.075\%$ of span when turndowns exceed 10: to 20:1.

The IGP25 can be considered a true multirange transmitter because its performance is maintained over a very wide turndown range, meaning that it performs as well as, or better than, two separate transmitters designed to cover the same turndown range.

DIGITAL AND 4 TO 20 mA OUTPUT VERSIONS

The IGP25 is offered with HART or FOUNDATION Fieldbus communication protocols. See paragraphs that follow.

Digital HART and 4 to 20 mA dc (Version -T Electronics)

4 to 20 mA with HART communications. Allows direct analog connection to common receivers while still providing full Intelligent Transmitter Digital Communications using a PC-based Configurator, HART Communicator, or optional LCD Indicator with on-board pushbuttons for local configuration and calibration.

4 to 20 mA dc (Configurable) (Version -D Electronics)

Allows direct analog connection to common receivers while still providing full Intelligent Transmitter Digital Communications with a PC-based Configurator, applicable I/A Series system FBMs, or optional LCD Indicator with on-board pushbuttons for configuration and calibration.

Digital FOUNDATION Fieldbus (Version -F Electronics)

This all digital, serial, two-way communication system interconnects field devices, such as transmitters, actuators, and controllers. It is a Local Area Network (LAN) with built-in capability to distribute control application across the network. Fieldbus technology consists of a Physical Layer, a Communication Stack, and User Application Blocks. The Communication Stack includes an LAS (Link Access Scheduler), and the User Application Blocks include AI (analog input) and PID (proportional, integral, derivative) function blocks. Interoperability of fieldbus devices is achieved using device addresses (IDs) and DDs.

EXCEPTIONAL VALUE

Small size, light weight, direct mounting, standard materials, and wide measurement capability with high performance make this an exceptionally cost effective solution for process pressure measurement.

DIRECT PROCESS MOUNTING

Because of their light weight and external threaded connection, these transmitters can be installed directly on process piping without mounting brackets. However, for unique requirements, optional bracket sets are offered and connection can be made to the standard 1/4 NPT internal thread.

EASE OF INSTALLATION

Rotatable Topworks allows transmitter installation in tight places, allows indicator to be positioned in preferred direction, and eases field retrofit.

Two Conduit Entrances offer a choice of entry positions for ease of installation and self-draining of condensation regardless of mounting position and topworks rotation.

Wiring Guides and Terminations provide ease of wire entry, plenty of space to work and store excess wire, and large, rugged screw terminals for easy wire termination.

316L SS PROCESS WETTED PARTS

With process connection and sensor diaphragm available in industry standard 316L ss, this transmitter is an excellent choice for the vast majority of process pressure measurements.

FISCO/FNICO COMPLIANT

FOUNDATION Fieldbus version certified by ATEX, CSA, FM, and IECEx for FISCO field device intrinsically safe, and FNICO field device protection n installations. Also certified for intrinsically safe and nonsparking user entity parameters.

COMPLIANCE WITH EUROPEAN UNION DIRECTIVES

- ▶ Complies with Electromagnetic Compatibility Requirements of European EMC Directive 2014/30/EU by conforming to EN61326-1:2013 Class A Emissions and Industrial Immunity Levels.
- ▶ Complies with NAMUR NE 21 Interference Immunity Requirement (EMC).
- ▶ Analog output complies with NAMUR NE 43 overrange and underrange annunciations.

HAZARDOUS AREA INSTALLATIONS

Certified for a wide variety of hazardous area requirements. See Figure for standard and flameproof versions.

Figure 1. IGP25 Transmitters
(Flameproof Version Shown on Left)



OPTIONAL LCD DIGITAL INDICATOR

A two-line digital indicator with on-board pushbuttons is available to display the measurement with a choice of units. The pushbuttons allow zero and span adjustments, as well as local configuration, without the need for a hand-held or PC-based configurator.

SANITARY AND PULP AND PAPER VERSIONS

These transmitters are also available with integral process connections for use in sanitary, and also pulp and paper installations. See PSS 2A-1C13 M and PSS 2A-1C13 N, respectively.

PRESSURE SEALS

Pressure seals are used with the IGP25 when it is necessary to keep the transmitter isolated from the process. A sealed system is used for a process fluid that may be corrosive, viscous, subject to temperature extremes, toxic, sanitary, or tend to collect and solidify.

Figure 1 lists the various seals that can be used with these transmitters. To order a transmitter with seals, both a Transmitter Model Number and Seal Model Number are required. Refer to PSS 2A-1Z11 A for a complete listing of pressure seal models and specifications.

Figure 2. Typical IGP25 Transmitter Configurations with Seals



Table 1. Pressure Seals Used with IGP25 Transmitters

Direct Connect Pressure Seal Assemblies		
Seal Model	Seal Description	Process Connections
PSFAD	Flanged, Direct Connect, Recessed Diaphragm	ANSI Class 150, 300, 600, 1500 flanges
PSFFD	Flanged, Direct Connect, Flush Diaphragm	ANSI Class 150, 300, 600 and PN 10/40
PSTAD	Threaded, Direct Connect, Recessed Diaphragm	1/4, 1/2, 3/4, 1, or 1 1/2 NPT internal thread
PSISD	In-Line Saddle Weld, Direct Connect, Recessed Diaphragm	Lower housing of seal is in-line saddle welded nominal 3- or 4-inch pipe
Remote Mount Pressure Seal Assemblies		
PSFPS	Flanged, Remote Mount, Flush Diaphragm	ANSI Class 150/300/600 flanges and BS/DIN PN 10/40 flanges
PSFES	Flanged, Remote Mount, Extended Diaphragm	ANSI Class 150/300/600 flanges and BS/DIN PN 10/40, 25/40 flanges
PSFFR	Flanged, Remote Mount, Flush Diaphragm	ANSI Class 150, 300, 600 flanges and DIN/BS PN 10/40
PSFAR	Flanged, Remote Mount, Recessed Diaphragm	ANSI Class 150/300/600/1500 flanges
PSTAR	Threaded, Remote Mount, Recessed Diaphragm	1/4, 1/2, 3/4, 1, or 1 1/2 NPT internal thread
PSISR	In-Line Saddle Weld, Remote Mount, Recessed Diaphragm	Lower housing of seal in-line saddle welded to nominal 3- or 4-inch pipe
PSSCR	Sanitary, Remote Mount, Flush Diaphragm	Process connection secured with a Tri-Clamp to a 2-, 3-, or 4-inch pipe
PSSSR	Sanitary, Remote Mount, Extended Diaphragm	Tank Spud Seal; 2- or 4-in Tri-Clamp; 2-, 6-, or 9-inch extension

FUNCTIONAL SPECIFICATIONS

Span and Range Limits

Span Limit Code	Span Limits			Range Limits		
D	0.0035 and 1.4	0.5 and 200	0.035 and 14	0 and 1.4	0 and 200	0 and 14
E	0.035 and 14	5 and 2000	0.35 and 140	0 and 14	0 and 2000	0 and 140

Maximum Overrange and Proof Pressure Ratings

Span Limit Code	Maximum Overrange Pressure Rating (a)			Proof Pressure Rating (b)		
	MPa	psi	bar	MPa	psi	bar
D	2.1	300	21	5.6	710	56
E	21	3000	210	56	7100	560

a. Maximum overrange pressure is the maximum pressure that may be applied without causing damage to the transmitter.

b. Proof pressure ratings meet ANSI/ISA Standard S82.03-1988. Unit may become nonfunctional after application of proof pressure.

Output Signal and Configuration

HART Protocol

4 to 20 mA, with digital HART communications. For multidrop applications, the mA signal is fixed at 4 mA to provide power to the device. Configurable using HART communicator, PC-based Configurator, or optional LCD Indicator.

FOUNDATION Fieldbus Protocol

FOUNDATION Fieldbus digital, serial, two-way communication system that runs at 31.25 kbits/s. The digital output signal is superimposed on the dc power signal on the bus, and controlled by a strict cycle schedule and protocol. Configurable using Host Computer (I/A Series system or a PC) having a Fieldbus interface PWA, or optional LCD Indicator.

Electronics and Sensor Temperatures

Readable from I/A Series system, HART Communicator, PC-based Configurator, or Fieldbus Host System. Measurement is transmitter temperature at the sensor and the electronics module, not necessarily process temperature.

Adjustable Damping

The transmitter response time is normally 0.75 s, or the electronically adjustable setting of 0.00 (none), 0.25, 0.50, 1, 2, 4, 8, 16, or 32 seconds, whichever is greater, for a 90% recovery from an 80% input step as defined in ANSI/ISA S51.1. With Fieldbus, damping can be set in both the transducer and AI (Analog Input) function blocks.

Field Wiring Reversal

No transmitter damage.

Zero and Span Adjustments

Zero and span adjustments can be initiated from the I/A Series Workstation (with applicable FBMs), HART Communicator, PC-based Configurator, or optional LCD Indicator with on-board pushbuttons.

Zeroing for Nonzero-Based Ranges

Dual Function Zeroing is provided to allow zeroing with the transmitter open to atmosphere, even when there is a nonzero-based range. This greatly simplifies position effect zeroing on many pressure and level applications. It even applies to the LCD Indicator and External Zero Adjustment options.

Suppressed Zero

Suppressed zero ranges are acceptable as long as the Span and Range Limits are not exceeded.

Current Outputs for Overrange, Fail, and Offline Conditions - HART Only

Parameter	HART
OFFLINE	User configurable between 4 and 20 mA
SENSOR FAILURE	User configurable to Fail LO or Fail HI
FAIL LO	3.60 mA
UNDERRANGE	3.80 mA
OVERRANGE	20.50 mA
FAIL HI	21.00 mA

Supply Voltage

HART 4 to 20 mA OUTPUT (Figure 3)

Minimum supply voltage of 11.5 V dc can be reduced to 11 V dc by using a plug-in jumper across the test receptacles in the field wiring compartment terminal block. An optional plug-in shorting bar is offered for this purpose.


4 to 20 mA (Figure 3)

Nominal minimum supply voltage is 11.5 V dc. This value can be reduced to 11 V dc by using a plug-in jumper across the test receptacles in the field wiring compartment terminal block. An optional plug-in shorting bar is offered for this purpose.

FOUNDATION Fieldbus Digital Output

9 to 32 V dc, by a specific fieldbus power source connected to the bus. For intrinsically safe (I.S.) applications, the supply voltage allowed can vary depending on the rating of the I.S. barrier.

Figure 3. 4 to 20 mA Output, Supply Voltage vs. Output Load

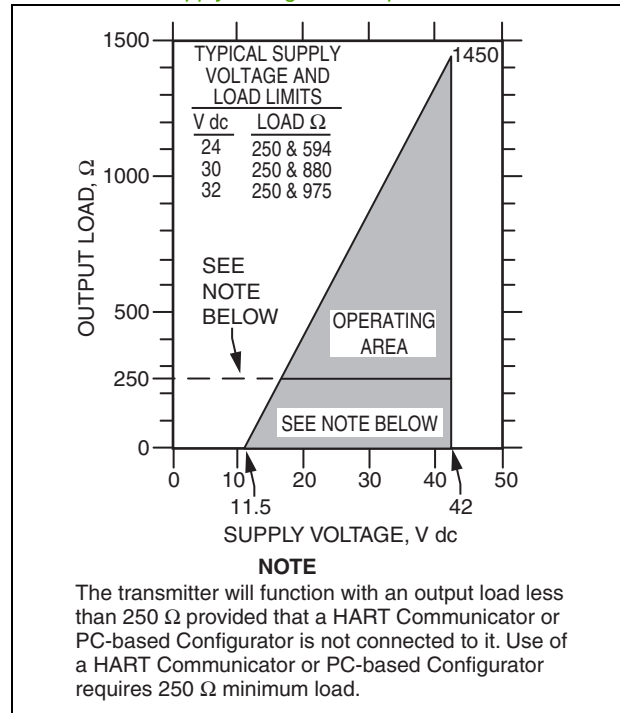

Write Protect Jumper

Can be positioned to lock out all configurators from making transmitter database changes. This makes transmitter suitable for Safety Shutdown System Applications that require this feature.

Configuration and Calibration Data, and Electronics Upgradeability

All factory characterization data, and user configuration and calibration data are stored in the sensor. This means that the electronics module can be replaced or changed from one type to another. A module may be replaced without the need for reconfiguration or recalibration. Although module replacement can affect accuracy up to 0.20% of span, this error can be removed by an mA trim without application of pressure.

Changing module types may require reconfiguration and recalibration, as well as a different terminal block, if applicable, but all factory characterization data is retained.

4 to 20 mA Analog Mode

Output is updated a minimum of 30/second. A minimum loop load of 250 ohms is required. See Table 2.

HART Communications

HART 4 to 20 mA Analog Mode

Analog output signal is updated 30 times per second. A minimum loop load of 250 ohms is required. See Table 2.

HART Multidrop Mode (Fixed Current)

This Mode supports communications with up to 15 transmitters on a single pair of signal/power wires. The output signal is updated 4 times/second. A minimum loop load of 250 ohms is required. See Table 2.

FOUNDATION Fieldbus Communications

This serial, two-way communication system runs at 31.25 kbits/s. Digital output signal is superimposed on the dc power signal on the bus, and controlled by a strict cycle schedule and protocol. Supply voltage, 9 to 32 V dc, is by a specific Fieldbus power source. Current consumption is 19.5 mA. The maximum number of devices on a non-intrinsically safe bus is 32. For intrinsically safe bus systems, the maximum number is 5. Also see Table 2.

Table 2. Communication Parameters - HART and FOUNDATION Fieldbus

Parameter	HART		Fieldbus
	Analog Mode	Multidrop Mode	Digital
Remote Configurator	HART Communicator or PC-based Configurator		I/A Series System, PC or Fieldbus Host
Communication Rate	1200 baud	1200 baud	31.25 kbits/s
Communication Distance	3050 m (10,000 ft)	1525 m (5000 ft)	1900 m (6235 ft) (a)

a. The total bus length including all spurs. Maximum spur length is 120 m (395 ft). For hybrid installations, the maximum IS spur length is dependent on the field barrier used. For intrinsically safe bus installations, maximum spur length is 30 m (98 ft).

Configuration Capability

Calibrated Range

- ▶ Input range within Span and Range Limits
- ▶ Pressure EGU (see Table 3)

Output Measurement #1 — Digital Primary Variable and 4 to 20 mA (HART Only)

- ▶ Mode: Linear
- ▶ Units: Same as calibrated range

Output Measurement #2 — Digital Secondary Variable

- ▶ Mode: Linear
- ▶ Units: A common pressure EGU, or a custom EGU
- ▶ Measurements #1 and #2: These measurements may be swapped

NOTE

Many parameters can be configured and/or displayed such as electronic damping, failsafe direction, transmitter location, calibration, tag data, etc. See applicable configuration instructions for details.

Table 3. Allowable Pressure Units for Calibrated Range

inH ₂ O	inHg	Pa	mbar	psi
ftH ₂ O	mmHg	kPa	bar	atm
mmH ₂ O	cmHg (a)	MPa	g/cm ²	
cmH ₂ O (a)	dy/cm ² (a)	torr	kg/cm ²	

a. Available with Electronics Version -D only.

Optional External Zero Adjustment

An external pushbutton mechanism is isolated from the electronics compartment and magnetically activates an internal reed switch through the housing. This eliminates a potential leak path for moisture or contaminants to get into the electronics compartment. This external zero adjustment can be disabled by a configuration selection.

Optional LCD Indicator


Indicator provides:

- ▶ Two Lines; five numeric characters on top line (four when a minus sign is needed) and seven alphanumeric characters on bottom line.
- ▶ Measurement Readout; value on top line and units label on bottom line.
- ▶ Configuration and Calibration Prompts.

Two pushbuttons provide for:

- ▶ Configuration Functions.
- ▶ Calibration Functions.

Figure 4. LCD Indicator with Pushbuttons

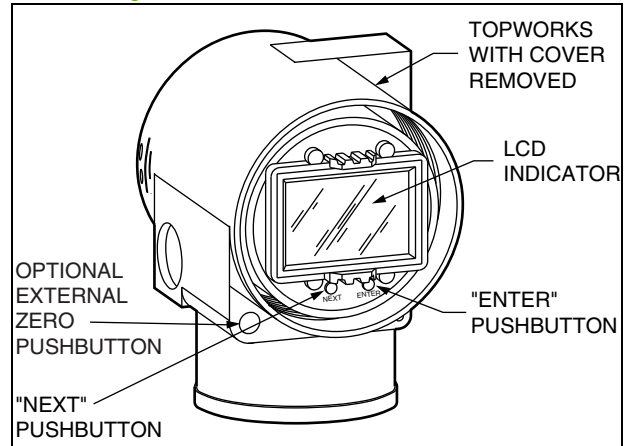

Optional Custom Configuration (Option -C2)

For the transmitter to be custom configured by the factory, the user must fill out a data form. If this option is not selected, a standard default configuration will be provided; for example:

Parameter	Standard (Default) Configuration	Example of Option -C2
Measurement 1	Linear	Linear
Device Name	DevNam	FT103A
External Zero	Enabled	Disabled
EGU	%	inH ₂ O
Damping	None	0.5 s

Typical Installation Topologies

Refer to Figures 5 through 8 for typical installation topologies.

Figure 5. HART 4 to 20 mA Topology

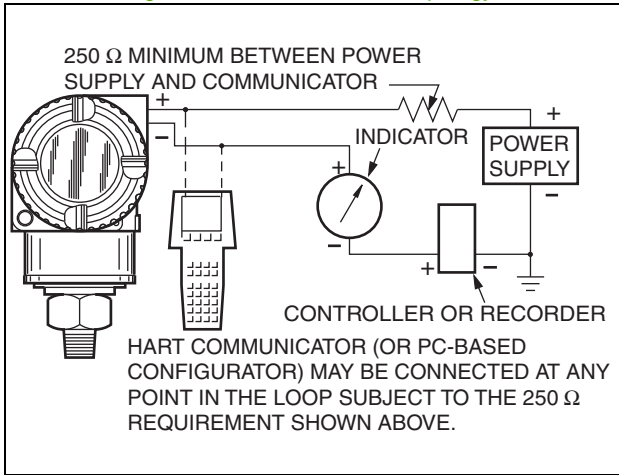


Figure 7. HART Multidrop Topology

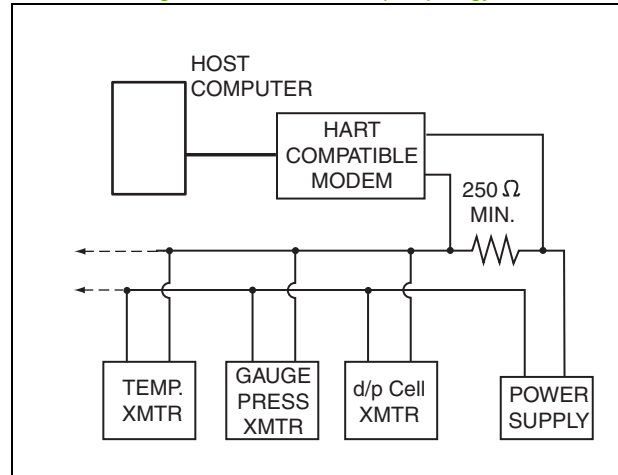


Figure 6. Fieldbus Miscellaneous Topologies


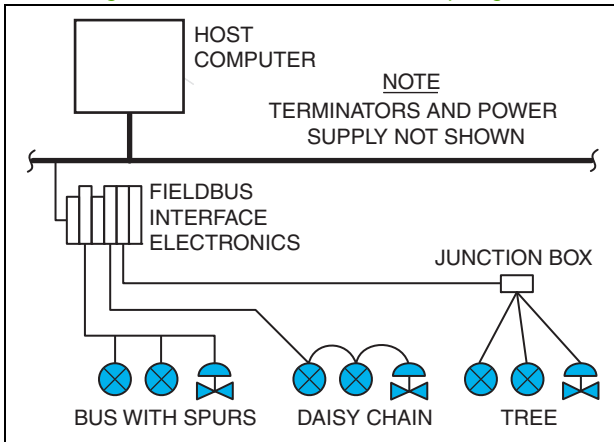


Figure 8. Fieldbus with Mixed Topologies

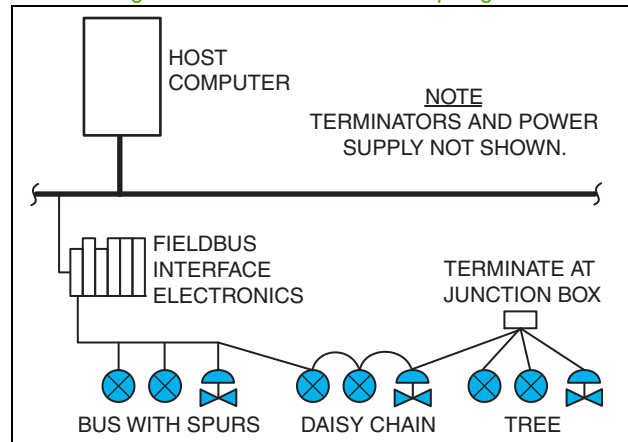

OPERATING, STORAGE, AND TRANSPORTATION CONDITIONS

Influence	Reference Operating Conditions	Normal Operating Conditions (a)	Operative Limits (a)	Storage and Transportation/Limits
Process Connection Temp. ▶ w/Silicone Fill Fluid ▶ w/Fluorinert Fill Fluid	▶ 24 ± 2°C (75 ± 3°F) ▶ 24 ± 2°C (75 ± 3°F)	▶ -29 to + 82°C (-20 to +180°F) ▶ -29 to + 82°C (-20 to +180°F)	▶ -46 and +121°C (b) (-50 and +250°F) (b) ▶ -29 and +121°C (-20 and +250°F)	▶ Not Applicable ▶ Not Applicable
Electronics Temperature (b) ▶ with LCD Indicator (c)	▶ 24 ± 2°C (75 ± 3°F) ▶ 24 ± 2°C (75 ± 3°F)	▶ -29 to + 82°C (d) (-20 to +180°F) (d) ▶ -20 to + 82°C (d) (-4 to +180°F) (d)	▶ -40 and +85°C (d) (-40 and +185°F) (d) ▶ -29 and +85°C (d) (-20 and +185°F) (d)	▶ -54 and +85°C (-65 and +185°F) ▶ -54 and +85°C (-65 and +185°F)
Relative Humidity (e)	50 ±10%	0 to 100%	0 and 100%	0 and 100% (e) Noncondensing
Supply Voltage – mA Output (HART)	30 ±0.5 V dc	11.5 to 42 V dc (f)	11.5 and 42 V dc (f)	Not Applicable
Output Load – mA Output (HART)	650 Ω (see Figure 4)	0 to 1450 Ω (g)	0 and 1450 Ω (g)	Not Applicable
Supply Voltage FOUNDATION Fieldbus	30 ±0.5 V dc	9 to 32 V dc (h)	9 and 32 V dc (h)	Not Applicable
Vibration	1 m/s ² (0.1 “g”)	6.3 mm (0.25 in) Double Amplitude: from 5 to 15 Hz with Aluminum Housing from 5 to 9 Hz with 316 ss Housing 0 to 30 m/s ² (0 to 3 “g”) from 15 to 500 Hz with Aluminum Housing; 0 to 10 m/s ² (0 to 1 “g”) from 9 to 500 Hz with 316 ss Housing	11 m/s ² (1.1 “g”) from 2.5 to 5 Hz (in Shipping Package)	
Mounting Position	Upright or Horizontal	Upright or Horizontal	No Limit	Not Applicable

- a. Normal Operating Conditions and Operative Limits are defined per ANSI/ISA 51.1-1979 (R1993).
- b. Selection of Option -J extends the low temperature operative limit of transmitters with silicone filled sensors down to -50°C (-58°F). Performance is not assured below -29°C. Sensor damage may occur if process is frozen.
- c. The optional LCD will not be damaged at any temperature within the “Storage and Transportation Limits”; however, updates will be slowed and readability decreased at temperatures outside the “Normal Operating Conditions”.
- d. Refer to the Electrical Safety Specifications section for a restriction in ambient temperature with certain electrical certifications.
- e. With topworks cover on and conduit entrances sealed. Also noncondensing during transportation and storage.
- f. 11.5 V dc can be reduced to 11 V dc by using the optional plug-in shorting bar. See Physical Specifications section.
- g. With HART, 250 Ω minimum load required for proper communication.
- h. Power supplied by a specific Fieldbus power supply.

PERFORMANCE SPECIFICATIONS

Zero-Based Calibrations; 316L ss Diaphragm with Silicone Fluid; Under Reference Operating Conditions unless otherwise Specified; URL = Upper Range Limit, and Span = Calibrated Span.

Accuracy (Includes Linearity, Hysteresis, and Repeatability)

Accuracy, % of Span (a)	
For Spans ≥1.25% URL	For Spans <1.25% URL
±0.050%	±[0.000625 (URL/Span)]%

a. Applies to HART 4 to 20 mA and FOUNDATION Fieldbus.

Stability

Long term drift is ±0.15% of URL for 10 years (reference conditions).

Calibration Frequency

The calibration frequency is five years. The five years is derived using the values of allowable error (% span), TPE (% span), performance margin (% span), and stability (% span/month); where:

$$\text{Calibration Frequency} = \frac{\text{Performance Margin}}{\text{Stability}} = \text{Months}$$

Power-Up Time

Less than 5 seconds for output to reach first valid measurement.

RFI Effect

The output error is less than 0.1% of span for radio frequencies in the range of 27 to 1000 MHz and field intensity of 30 V/m when the transmitter is properly installed with shielded cable in conduit and earthing (grounding), and housing covers are in place. (Per IEC Std. 61000-4-3.)

Supply Voltage Effect

The output changes less than 0.005% of span for each 1 V change within the specified supply voltage requirements.

Position Effect

The transmitter may be mounted in any position. Any zero effect caused by the mounting position can be eliminated by rezeroing. There is no span effect.

Ambient Temperature Effect

Total effect for a 28°C (50°F) change within Normal Operating Condition limits is:

$$\pm(0.03\% \text{ URL} + 0.06\% \text{ Span})$$

NOTE

For additional ambient temperature effect when pressure seals are used, see PSS 2A-1Z11 A.

Vibration Effect

Total effect is ±0.2% of URL per “g” for vibrations in the frequency range of 5 to 500 Hz; with double amplitudes of 6.3 mm (0.25 in) in the range of 5 to 15 Hz, or accelerations of 3 “g” in the range of 15 to 500 Hz, whichever is smaller, for transmitters with aluminum housings; and with double amplitudes of 6.3 mm (0.25 in) in the range of 5 to 9 Hz, or accelerations of 1 “g” in the range of 9 to 500 Hz, whichever is smaller, for transmitters with 316 ss housings.

Switching and Indirect Lightning Transients

The transmitter can withstand a transient surge up to 2000 V common mode or 1000 V normal mode without permanent damage. The output shift is less than 1.0%. (Per ANSI/IEEE C62.41-1980 and IEC Std. 61000-4-5.)

PHYSICAL SPECIFICATIONS

Environmental Protection

The enclosure has the dusttight and weatherproof rating of IP66 as defined by IEC 60529, and provides the environmental and corrosion resistant protection rating of NEMA 4X.

Process Wetted Materials (High Pressure Side)

Industry Standard 316L ss for process connection and sensor diaphragm

Reference Side Materials (Atmospheric Side)

Silicon, Pyrex, RTV, and 316 ss.

Sensor Fill Fluids

Silicone Oil or Inert (FC-43)

Electronics Housing and Housing Covers

Housing has two compartments to separate the electronics from the field connections. The housing and covers are made from low copper (0.6% maximum) die-cast aluminum alloy with an epoxy finish, or from 316 ss. Buna-N O-ring seals are used to seal the threaded housing covers, housing neck, and terminal block.

Electronics Module

Printed wiring assemblies are conformally coated for moisture and dust protection.

Mounting Position

The transmitter may be mounted in any orientation.

Electrical Connections

Field wires enter through 1/2 NPT, PG 13.5, or M20 threaded entrances on either side of the electronics housing. Wires terminate under screw terminals and washers on terminal block in the field terminal compartment (Figure). Unused entrance is plugged to insure moisture and RFI/EMI protection.


Approximate Mass

- ▶ 1.5 kg (3.3 lb) – with Aluminum Housing
- ▶ Add 1.1 kg (2.4 lb) – with 316 ss Housing
- ▶ Add 0.2 kg (0.4 lb) – with LCD Indicator Option
- ▶ With Pressure Seals – see PSS 2A-1Z11 A.

Dimensions

See “Dimensions – Nominal”

Figure 9. Field Terminals Compartment for HART and Fieldbus

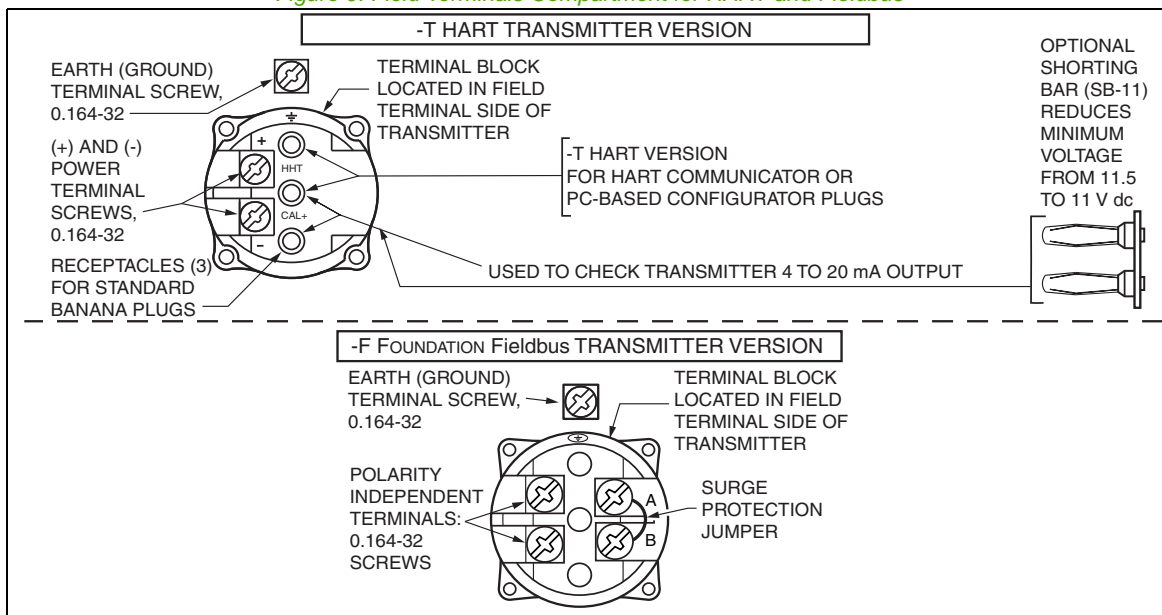

ELECTRICAL SAFETY SEPCIFICATIONS

The transmitter has been designed to meet the Electrical Safety Specifications listed in the tables that follow. Contact Global Customer Support for information or status of testing laboratory approvals or certifications.

With Electrical Safety Design Codes M and P, the user must permanently mark (check off on rectangular box on data plate) one type of protection only (ia and ib, d, or n). Do not change this mark once it has been applied.

When selecting Safety Design Code W (for HART only), the user must permanently mark (check off in rectangular block on data plate) intrinsically safe certifications for ATEX, CSA, or FM, as applicable. Do not change this mark once it has been applied.

Electronic Version -T, HART

Testing Laboratory, Types of Protection, and Area Classification	Application Conditions	Elec. Safety Design Code
ATEX intrinsically safe; II 1 GD, EEx ia IIC, Zone 0, or II 1/2 GD EEx ib IIC, Zone 0/Zone 1.	Temperature Class T4; Ta = -40 to +80°C Temperature Class T5; Ta = -40 to +40°C Temperature Class T6; Ta = -40 to +40°C	E
ATEX flameproof; II 2 GD, EEx d IIC, Zone 1.	Temperature Class T6, 85°C; Ta = -40 to +80°C	D
ATEX protection n; II 3 GD, EEx nL IIC, Zone 2.	Temperature Class T4; Ta = -40 to +80°C Temperature Class T5; Ta = -40 to +70°C Temperature Class T6; Ta = -40 to +40°C	N
ATEX multiple certifications, ia & ib, and n. Refer to Codes E and N for details.	Applies to Codes E and N, but not to Code D (Note 2)	M
ATEX multiple certifications, ia & ib, d, and n. Refer to Codes D, E and N for details.	Applies to Codes D, E, and N (Note 2)	P
CSA intrinsically safe for Class I, Div. 1, Groups A, B, C, and D, Class II, Div. 1, Groups E, F, and G, and Class III, Div. 1.	Connect per MI 020-427. Temperature Class T6 at 40°C, and T3C at 85°C maximum ambient	C
CSA zone certified intrinsically safe Ex ia IIC, and energy limited Ex nA II.	Temperature Class T4 at 40°C, and T3 at 85°C maximum ambient	C
CSA explosionproof for Class I, Div. 1, Groups B, C, and D; dust-ignitionproof for Class II, Div. 1, Groups E, F, and G; and Class III, Div. 1.	Maximum Ambient Temperature 85°C	C
CSA for Class I, Div. 2, Groups A, B, C, and D; Class II, Div. 2, Groups F and G; Class III, Div. 2.	Temperature Class T6 at 40°C and T4A at 85°C maximum ambient	C
CSA field device zone certified flameproof Ex d IIC. Also, all certifications of Code C above.	Maximum Ambient Temperature 85°C	B
EAC flameproof 1Ex d IIC Gb	T6 (-40/50°C ≤ Ta ≤ +75°C)	6
EAC flameproof Ex tb IIIC Db	T85°C -40/-50°C ≤ Ta ≤ +80°C	6
EAC flameproof Ex tc IIIC Dc	T85°C -40°C ≤ Ta ≤ +80°C	6
EAC intrinsically safe, Zone 0 Ex ia IIC Ga	T4 (-40°C ≤ Ta ≤ +80°C)	4
EAC intrinsically safe, Zone 2 Ex ic IIC Gc	T4 (-40°C ≤ Ta ≤ +80°C)	5
EAC non sparking, Zone 2 Ex nA IIC Gc	T4 (-40°C ≤ Ta ≤ +80°C)	5

Electronic Version -T, HART (Continued)

Testing Laboratory, Types of Protection, and Area Classification	Application Conditions	Elec. Safety Design Code
FM intrinsically safe for Class I, Div. 1, Groups A, B, C, and D; Class II, Div. 1, Groups E, F, and G; and Class III, Div. 1.	Connect per MI 020-427. Temperature Class T4A at 40°C and T4 at 85°C maximum ambient	F
FM zone certified intrinsically safe AEx ia IIC.	Temperature Class T4 at 85°C maximum ambient	F
FM explosionproof for Class I, Div. 1, Groups B, C, and D; dust-ignitionproof for Class II, Div. 1, Groups E, F, and G; and Class III, Div. 1.	Temperature Class T6 at 80°C and T5 at 85°C maximum ambient	F
FM nonincendive Class I, Div. 2, Groups A, B, C, and D; Class II, Div. 2, Groups F and G; and Class III, Div. 2.	Temperature Class T4A at 40°C and T4 at 85°C maximum ambient	F
FM field device zone certified flameproof AEx d IIC. Also, all certifications of Code F above.	Temperature Class T6 at 75°C maximum ambient.	G
IECEX flameproof, Ex d IIC.	Temperature Class T6; Ta = -40 to +75°C.	V
INMETRO flameproof Ex d IIC Gb	T6 (-40°C ≤ Ta ≤ +75°C)	2
INMETRO intrinsically safe Ex ia IIC Ga	T4 (-40°C ≤ Ta ≤ +80°C)	1
KOSHA flameproof Ex d IIC	T6 T _{amb} = -50°C to +80°C	3
Multi-marked as follows: CSA intrinsically safe, Cl. I, Div. 1, Groups A, B, C, D; Class II, Div. 1, Groups E, F, G; Class III, Div. 1; also CSA zone certified intrinsically safe Ex ia IIC. FM intrinsically safe, Cl. I, Div. 1, Groups A, B, C, D; Class II, Div. 1, Groups E, F, G; Class III, Div. 1. Also FM zone certified intrinsically safe AEx ia IIC. ATEX intrinsically safe, II 1 GD, EEx ia IIC, Zone 0.	See application conditions for Code C intrinsically safe applications. See application conditions for Code F intrinsically safe applications. See application conditions for Code E intrinsically safe applications.	W

Electronic Version -F, FOUNDATION Fieldbus

Testing Laboratory, Types of Protection, and Area Classification	Application Conditions	Elec. Safety Design Code
ATEX FISCO field device intrinsically safe; II 1 G, EEx ia IIC, Zone 0.	Temperature Class T4; Ta = -40 to +80°C.	E
ATEX flameproof; II 2 GD, EEx d IIC, Zone 1.	Temperature Class T6, 85°C; Ta = -40 to +80°C.	D
ATEX FNICO field device protection n: II 3 G EEx nL IIC, Zone 2.	Temperature Class T4; Ta = -40 to +80°C.	N
CSA FISCO field device intrinsically safe for Class I, Division 1, Groups A, B, C, and D; Class II, Division 1, Groups E, F, and G; Class III, Division 1. Also zone certified intrinsically safe Ex ia IIC, and energy limited Ex nA II.	Temperature Class T6 at 40°C, and T4A at 85°C maximum ambient. Temperature Class T4 at 40°C, and T3 at 85°C maximum ambient.	C
CSA explosionproof for Class I, Division 1, Groups B, C, and D; and dust-ignitionproof for Class II, Division 1, Groups E, F, and G; and Class III, Division 1.	Maximum Ambient Temperature 85°C.	C
CSA FNICO field device Class I, Division 2, Groups A, B, C, and D; Class II, Division 2, Groups F and G; and Class III, Division 2.	Temperature Class T6 at 40°C and T4A at 85°C maximum ambient.	C
CSA field device zone certified flameproof Ex d IIC. Also, all certifications of Code C above.	Maximum Ambient Temperature 85°C.	B
EAC flameproof 1Ex d IIC Gb	T6 (-40/50°C ≤ Ta ≤ +75°C)	6
EAC flameproof Ex tb IIIC Db	T85°C -40/-50°C ≤ Ta ≤ +80°C	6
EAC flameproof Ex tc IIIC Dc	T85°C -40°C ≤ Ta ≤ +80°C	6
EAC FISCO intrinsically safe, Zone 0 Ex ia IIC Ga	T4 (-40°C ≤ Ta ≤ +80°C)	4
EAC FISCO intrinsically safe, Zone 2 Ex ic IIC Gc	T4 (-40°C ≤ Ta ≤ +80°C)	5
EAC non sparking, Zone 2 Ex nA IIC Gc	T4 (-40°C ≤ Ta ≤ +80°C)	5
FM FISCO field device intrinsically safe for Class I, Division 1, Groups A, B, C, and D; Class II, Division 1, Groups E, F, and G; Class III, Division 1. Also zone approved intrinsically safe AEx ia IIC.	Temperature Class T4A at 40°C and T4 at 85°C maximum ambient. Temperature Class T4 at 85°C maximum ambient.	F
FM FNICO field device nonincendive Class I, Division 2, Groups A, B, C, and D; Class II, Division 2, Groups F and G, and Class III, Division 2.	Temperature Class T4A at 40°C and T4 at 85°C maximum ambient.	F
FM explosionproof for Class I, Div. 1, Groups B, C, and D; dust-ignitionproof for Class II, Div. 1, Groups E, F, and G; and Class III, Div. 1.	Temperature Class T6 at 80°C and T5 at 85°C maximum ambient.	F
FM field device zone certified flameproof AEx d IIC. Also, all certifications of Code F above.	Temperature Class T6 at 75°C maximum ambient.	G
IECEX FISCO field device intrinsically safe; Ex ia IIC, Zone 0.	Temperature Class T4; Ta = -40 to +80°C.	T
IECEX flameproof, Ex d IIC.	Temperature Class T6; Ta = -40 to +75°C.	V

MODEL CODE

Electronic Version -F, FOUNDATION Fieldbus (Continued)

Testing Laboratory, Types of Protection, and Area Classification	Application Conditions	Elec. Safety Design Code
IECEX FNICO field device protection n: Ex nL IIC, Zone 2.	Temperature Class T4; Ta = -40 to +80°C.	U
INMETRO flameproof Ex d IIC Gb	T6 (-40°C ≤ Ta ≤ +75°C)	2
INMETRO FISCO intrinsically safe Ex ia IIC Ga	T4 (-40°C ≤ Ta ≤ +80°C)	1
KOSHA flameproof Ex d IIC	T6 T _{amb} = -50°C to +85°C	3

MODEL CODE

Description	Model
I/A Series, Multirange, Direct Connected Gauge Pressure Transmitter (a)	IGP25
Electronics Versions and Output Signal	
Intelligent; Digital HART and 4 to 20 mA dc (Version -T)	-T
Intelligent; Digital FOUNDATION Fieldbus (Version -F)	-F
Structure Code - Select from one of the following six groups:	
1. Transmitter Only (no seals)	
Process	
Connection Sensor Fill Fluid Connection Type	
316L ss 316L ss Silicone 1/2 NPT External Thread, 1/4 NPT Internal Thread	22
316L ss 316L ss Inert 1/2 NPT External Thread, 1/4 NPT Internal Thread	23
2. Transmitter Prepared for Foxboro Model Coded Seals (b)	
Transmitter Prepared for Foxboro Direct Connect Seal; Silicone Fill in Sensor (c)	D1
Transmitter Prepared for Foxboro Direct Connect Seal; Inert Fill in Sensor (c)	D2
Transmitter Prepared for Foxboro Remote Mount Seal; Silicone Fill in Sensor (d)	S3
Transmitter Prepared for Foxboro Remote Mount Seal; Inert Fill in Sensor (d)	S4
3. Transmitters Prepared for non-Foxboro Seals	
Transmitter Prepared for Remote Seal; Silicone Fill in Sensor (e)	SC
Transmitter Prepared for Remote Seal; Inert Fill in Sensor (f)	SD
4. Flameproof Transmitter Only (no seals)	
Process	
Connection Sensor Fill Fluid Connection Type	
316L ss 316L ss Silicone 1/2 NPT External Thread, 1/4 NPT Internal Thread	52
316L ss 316L ss Inert 1/2 NPT External Thread, 1/4 NPT Internal Thread	53
5. Flameproof Transmitter Prepared for Foxboro Model Coded Seals (b)	
Flameproof Transmitter Prepared for Direct Connect Seal; Silicone Fill in Sensor (c)	D5
Flameproof Transmitter Prepared for Direct Connect Seal; Inert Fill in Sensor (c)	D6
Flameproof Transmitter Prepared for Remote Mount Seal; Silicone Fill in Sensor (d)	S5
Flameproof Transmitter Prepared for Remote Mount Seal; Inert Fill in Sensor (d)	S6
6. Flameproof Transmitter Prepared for non-Foxboro Seals	
Flameproof Transmitter Prepared for Remote Seal; Silicone Fill in Sensor (e)	SH
Flameproof Transmitter Prepared for Remote Seal; Inert Fill in Sensor (f)	SJ

MODEL CODE (CONTINUED)

Description (Continued)	Model									
Span Limits										
<table border="0"> <tr> <td style="text-align: center;">MPa</td> <td style="text-align: center;">psi</td> <td style="text-align: center;">bar</td> </tr> <tr> <td>0.0035 and 1.4</td> <td>0.5 and 200</td> <td>0.035 and 14</td> </tr> <tr> <td>0.035 and 14</td> <td>5 and 2000</td> <td>0.35 and 140</td> </tr> </table>	MPa	psi	bar	0.0035 and 1.4	0.5 and 200	0.035 and 14	0.035 and 14	5 and 2000	0.35 and 140	D E
MPa	psi	bar								
0.0035 and 1.4	0.5 and 200	0.035 and 14								
0.035 and 14	5 and 2000	0.35 and 140								
Conduit Connection and Housing Material										
1/2 NPT Conduit Connection, Aluminum Housing	1									
PG 13.5 Conduit Connection, Aluminum Housing (Electrical Safety Codes E, D, M, N, and P only)	2									
1/2 NPT Conduit Connection, 316 ss Housing	3									
PG 13.5 Conduit Connection, 316 ss Housing (Electrical Safety Codes E, D, M, N, and P only)	4									
M20 Conduit Connection, Both Sides, Aluminum Housing (Electrical Safety Codes E, D, M, N, P only)	5									
M20 Conduit Connection, Both Sides, 316 ss Housing (Electrical Safety Codes E, D, M, N, P only)	6									
Electrical Safety (Also see Electrical Safety Specifications Section)										
INMETRO	1									
intrinsically safe Ex ia IIC Ga (Brazil) (with Electronics Version -T only)										
FISCO intrinsically safe Ex ia IIC Ga (Brazil) (with Electronics Version -F only)										
INMETRO flameproof Ex d IIC Gb (Brazil) (g)	2									
KOSHA flameproof Ex d IIC (Korea) (g)	3									
EAC	4									
intrinsically safe Zone 0 Ex ia IIC Ga (Russia) (with Electronics Version -T only)										
FISCO intrinsically safe Zone 0 Ex ia IIC Ga (Russia) (with Electronics Version -F only)										
EAC	5									
intrinsically safe Zone 2 Ex ic IIC Gc (Russia) (with Electronics Version -T only)										
FISCO intrinsically safe Zone 2 Ex ic IIC Gc (Russia) (with Electronics Version -F only)										
non sparking Zone 2 Ex nA IIC Gc (Russia)										
EAC	6									
flameproof 1Ex d IIC Gb (Russia) (g)										
flameproof 1Ex tb IIIC Db (Russia) (g)										
flameproof 1Ex tc IIIC Dc (Russia) (g)										
ATEX II 1 GD, EEx ia IIC, Zone 0; or II 1/2 GD, EEx ib IIC, Zone 0/1 (Versions D and T only)	E									
ATEX FISCO, II 1 G, EEx ia IIC, Zone 0 (Version F only)	E									
ATEX II 2 GD, EEx d IIC, Zone 1 (g) (h)	D									
ATEX II 3 GD, EEx nL IIC, Zone 2 (Versions D and T only)	N									
ATEX FNICO, II 3 G, EEx nL IIC, Zone 2 (Version F only)	N									
ATEX Multiple Certifications (includes ATEX Codes E and N) (Versions D and T only)	M									
(See Electrical Safety Specifications section for <u>user marking</u>)										
ATEX Multiple Certifications (includes ATEX Codes E, D, and N) (Versions D and T only) (g) (h)	P									
(See Electrical Safety Specifications section for <u>user marking</u>)										
CSA Certifications: (i)	C									
Intrinsically Safe, Division 1, Classes I, II, and III (Versions D and T only)										
Zone Certified intrinsically safe, Ex ia IIC, and energy limited Ex nA II (Version T only)										
Explosionproof and dust-ignitionproof, Division I, Classes I, II, and III (All Versions)										
For Division 2, Classes I, II, and III (Versions D and T only)										
FISCO, intrinsically Safe, Division 1, Classes I, II, and III; (Version F only)										
FNICO, Division 2, Classes I, II, and III (Version F only)										
CSA Certifications: (g) (h)	B									
Zone certified flameproof, Ex d IIC. Also all certifications of Code C above (All Versions)										

MODEL CODE

MODEL CODE (CONTINUED)

Description (Continued)	Model
Electrical Safety (Also see Electrical Safety Specifications Section) (continued)	
FM Approvals (i) Intrinsically Safe, Division 1, Classes I, II, and III (Versions D and T only) Zone approved intrinsically safe, AEx ia IIC (Version T only) Explosionproof and dust-ignitionproof, Division I, Classes I, II, and III (All Versions) Nonincendive, Division 2, Classes I, II, and III (Versions D and T only) FISCO, intrinsically Safe, Division 1, Classes I, II, and III; (Version F only) FNICO, nonincendive, Division 2, (Version F only)	F
FM Approvals: Zone approved flameproof, AEx d IIC. Also all certifications of Code F above. (All Versions) (g) (h) IECEx FISCO, Ex ia IIC, Zone 0; Version F only IECEx flameproof, Ex d IIC; All Versions (g) (h) IECEx FNICO, Ex nL IIC, Zone 2; Version F only Multi-marked for ATEX, CSA, and FM Intrinsically Safe Applications (Version -T only) (j)	G T V U W
Optional Selections	
Mounting Bracket Set (k)	
Painted Steel Bracket with Plated Steel Bolts, 1/2 NPT (Conduit Connection Codes 1 and 3 only) Stainless Steel Bracket with Stainless Steel Bolts, 1/2 NPT (Conduit Connection Codes 1 and 3 only) Painted Steel Bracket with Plated Steel Bolts, PG 13.5 (Conduit Connection Codes 2 and 4 only) Stainless Steel Bracket with Stainless Steel Bolts, PG 13.5 (Conduit Connection Codes 2 and 4 only) Painted Steel Bracket with Plated Steel Bolts, M20 (Conduit Connection Codes 5 and 6 only) Stainless Steel Bracket with Stainless Steel Bolts, M20 (Conduit Connection Codes 5 and 6 only)	-M1 -M2 -M3 -M4 -M5 -M6
Digital Indicator with Pushbuttons	
Digital Indicator, Pushbuttons, and Window Cover	-L1
Vent Screw and Block & Bleed Valve	
316 ss Vent Screw in Process Connection (Not with Options -X1 and -X2, or Pressure Seals) Block and Bleed Valve, Carbon Steel (Not with Options -X1 and -X2, or Pressure Seals) Block and Bleed Valve, 316 ss (Not with Options -X1 and -X2, or Pressure Seals) Block and Bleed Valve, 316 ss w/Monel® Trim (Not with Options -X1 and -X2, or Pressure Seals)	-V1 -V2 -V3 -V4
Conduit Thread Adapters (Not available with Conduit Connection Codes 5 and 6)	
Hawke-Type 1/2 NPT Cable Gland for use with Conduit Connection Codes 1 and 3 only (l) Plastic PG 13.5 Cable Gland for use with Conduit Connection Codes 2 and 4 only (m) M20 Connector for use with Conduit Connection Codes 1 and 3 only (l) Brass PG 13.5 Cable Gland (Trumpet-Shaped); with Conduit Connection Codes 2 and 4 only (m)	-A1 -A2 -A3 -A4
Electronics Housing Features	
External Zero Adjustment Custody Transfer Lock and Seal External Zero Adjustment and Custody Transfer Lock and Seal	-Z1 -Z2 -Z3
Custom Factory Configuration	
Digital Output (4 to 20 mA default if not selected) (with Electronics Version -D only) Full Factory Configuration (Requires Configuration Form to be filled out)	-C1 -C2
Cleaning and Preparation	
Unit Degreased - for Silicone Filled Sensors Only Not for Oxygen/Chlorine Service, Options -V1 to -V4, or Pressure Seals Cleaned and Prepared for Oxygen Service - for Inert Filled Sensors Only Not with Option -V1 to -V4, or Pressure Seals	-X1 -X2
Instruction Books (Common MI, Brochure, and Full Documentation Set on DVD is Standard)	
Without Instruction Book and DVD - Only "Getting Started" Brochure is supplied	-K1

MODEL CODE (CONTINUED)

Description (Continued)	Model
Miscellaneous Optional Selections	
G 1/2 B Manometer Process Connection (Not Available with Option -V1 or Pressure Seals)	-G
Low Temperature Operative Limit of Electronics Housing Extended Down to -50°C (-58°F) (n) (o)	-J
R 1/2 Process Connection (1/2 NPT to R 1/2 Adapter) (p)	-R
Supplemental Customer Tag (Stainless Steel Tag wired onto Transmitter)	-T
Seventeen Year Warranty	-W
Example: IGP25–T22E3F–M3L1C2JT	

- a. Refer to PSS 2A-1C13 M and PSS 2A-1C13 N for IGP25 versions for the sanitary, and pulp/paper industries, respectively.
- b. Both transmitter and pressure seal Model Numbers are required. Refer to PSS 2A-1Z11 A for pressure seal Model Codes.
- c. Direct Connect Seal Models that may be specified are PSTAD, PSFAD, PSFFD, and PSISD.
- d. Remote Mount Seal Models that may be specified are PSFPS, PSFES, PSFFR, PSFAR, PSTAR, PSISR, PSSCR, and PSSSR.
- e. For transmitters with Silicone fill prepared for remote seal by others, specify Structure Code 22 or 52.
- f. For transmitters with Fluorinert fill prepared for remote seal by others, specify Structure Code 23 or 53.
- g. Electrical Safety Codes 2, 3, 6, B, D, G, P, and V are only available with flameproof transmitter Structure Codes 52, 53, D5, D6, S5, S6, SH, and SJ.
- h. A cover lock is provided as standard with Electrical Safety Codes D, B, G, and P.
- i. Electrical Safety Codes C, F, H, A, and K are not available with flameproof transmitter Structure Codes 52, 53, D5, D6, S5, S6, SH, and SJ.
- j. For multi-marking details, see Electrical Safety Specifications section.
- k. Mounting sets not offered with direct mounted seals, except if a direct mounted PSTAD threaded seal with a 1/4 NPT process connection is used, then a mounting set is recommended.
- l. Available with Electrical Safety Codes E, D, M, N, and P only.
- m. Available with Electrical Safety Code E only.
- n. Not available with Inert fill in sensor or seal.
- o. -50°C indicates sensor and electronics ambient temperature capabilities. Performance is not assured below -29°C. Sensor damage may occur if process is frozen.
- p. Not available with pressure seals or nickel alloy (equivalent to Hastelloy® C sensors. Hastelloy® is a registered trademark of Haynes International, Inc.).

SUGGESTED RFQ SPECIFICATIONS


The manufacturer shall provide direct connected, multirange pressure transmitters featuring HART or Foundation Fieldbus Communication Protocol. They shall provide remote digital communications capability for measuring gauge pressure and transmit a digital or 4 to 20 mA (HART only) output signal for use in a standard two-wire dc supply voltage system. These transmitters shall also be provided (as required) with direct or remote mount pressure seals. The specifications for these transmitters are as follows:

Communication Protocol:	HART Digital and/or 4 to 20 mA dc output signal FOUNDATION Fieldbus: Digital output signal
Communications:	Remote Communications must not interfere with output.
Span Turndown Ratio:	400:1
Accuracy:	±0.050% of calibrated span for spans ≥ 1.25% of URL.
Damping:	Settable for a range of none to 32 seconds.
RFI Protection:	0.1% error between 27 and 1000 MHz at 30 V/m field intensity
Proof Pressure:	710 or 7100 psi, depending on sensor selected.
Span Limits:	From 0.5 to 2000 psi using only two sensors.
Enclosure:	316 ss, or Aluminum enclosure with Epoxy finish
Modular Electronics:	Enclosed in a NEMA 4X/IEC IP66 rated housing sealed with O-rings to protect against moisture or other contaminants. Optional LCD Digital Indicator with on-board pushbuttons.
Mounting:	Direct to process or bracket mounted to pipe or surface.
Process Connection:	Direct connected to process piping with 1/2 NPT or optional R 1/2 or G 1/2 B external threads. Internal 1/4 NPT thread also provided as plumbing connection to process. Process connection can also be prepared for an installed Foxboro direct connect seal or capillary connected seal.
Sensor Materials:	Industry standard 316L ss.
Electrical Safety:	Nonincendive, flameproof, intrinsically safe, or explosionproof agency approvals. Versions available to meet Agency flameproof and zone requirements. Comply with applicable European Union Directives.
Approximate Mass:	Direct Connected Transmitter: 1.5 kg (3.3 lb); does not include seals. With 316 ss Electronics Housing: Add 1.1 kg (2.4 lb) With Optional LCD Indicator: Add 0.2 kg (0.4 lb)
Model Code:	Foxboro Model IGP25 Multirange Gauge Pressure Transmitter; with HART or FOUNDATION Fieldbus Communication Protocol; with or without pressure seals; or equivalent

DIMENSIONS - NOMINAL

$\frac{\text{mm}}{\text{in}}$

IGP25 DIRECT CONNECTED MULTIRANGE TRANSMITTERS

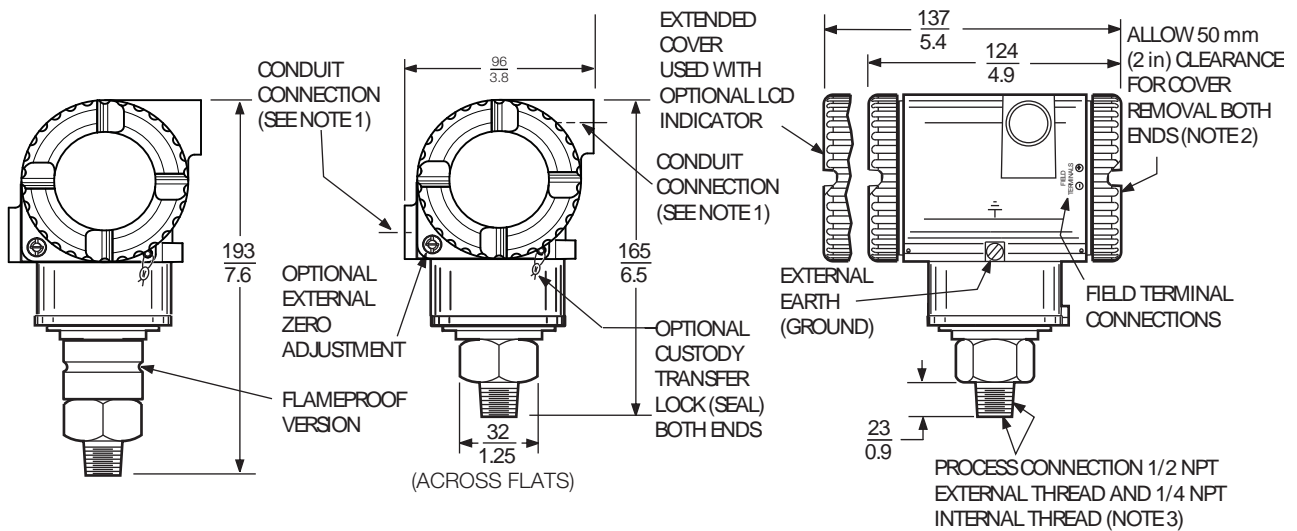


NOTES


1. CONDUIT CONNECTION 1/2 NPT, PG 13.5, OR M20, BOTH SIDES: PLUG UNUSED CONNECTION WITH METAL PLUG (SUPPLIED).
2. TOPWORKS ROTATABLE TO ANY POSITION WITHIN ONE TURN COUNTERCLOCKWISE OF FULLY TIGHTENED POSITION.
3. DO NOT USE 1/4 NPT INTERNAL THREAD TO DIRECT-CONNECT THE TRANSMITTER TO PROCESS.

$\frac{\text{mm}}{\text{in}}$


IGP25
WITH OPTIONS -M1 TO -M6

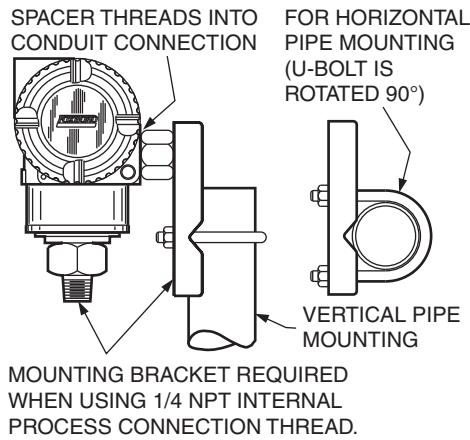


IGP25
VENT SCREW IN
PROCESS CONNECTOR
OPTION -V1

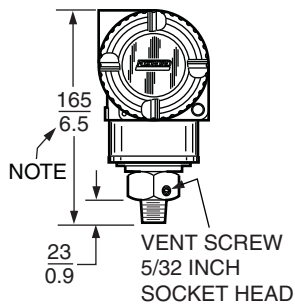


IGP25
PROCESS
CONNECTION
OPTION -G

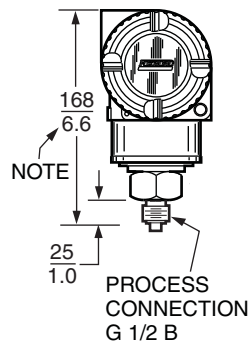

IGP25
METRIC PROCESS
CONNECTOR
OPTION -R

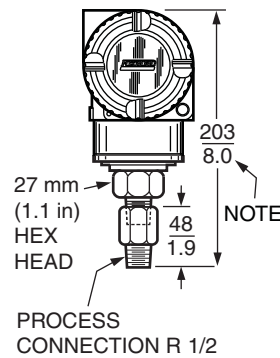

IGP25
BLOCK AND BLEED
VALVE OPTIONS
-V2, -V3, OR -V4

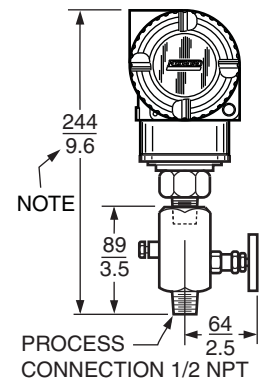

NOTES

1. FOR FLAMEPROOF TRANSMITTERS, ADD 28 mm (1.1in) TO OVERALL HEIGHT DIMENSION.
2. REFER TO DIMENSIONAL PRINT DP 020-447 FOR FURTHER INFORMATION.

ORDERING INSTRUCTIONS

1. Model Number(s) as follows:
 - ▶ Transmitter only if pressure seals are not selected
 - ▶ Both transmitter and pressure seal if pressure seal is selected.
See PSS 2A-1Z11 A.
2. Calibrated Pressure Range (using Allowable Pressure Units from the table below).

inH ₂ O	inHg	kPa	mbar	kg/cm ²
ftH ₂ O	mmHg	MPa	bar	psia
mmH ₂ O	Pa	torr	g/cm ²	atm

3. Configuration Data Form when Factory Calibration Option -C2 is specified.
4. Options and Accessories not in Model Code (see PSS 2A-1Z9 E).
5. User Tag Data – Data Plate; 32 characters maximum. For additional tag data, specify Optional Supplemental Tag -T.
6. User Tag Data - Software (Database):
 - ▶ HART, -T; 8 characters maximum
 - ▶ Fieldbus, -F; 32 characters maximum.

OTHER FOXBORO PRODUCTS

The Foxboro product lines offer a broad range of measurement and instrument products, including solutions for pressure, flow, analytical, temperature, positioning, controlling, and recording. For a list of these offerings, visit our web site at:

www.schneider-electric.com